


EAGLE Controller

Product Data

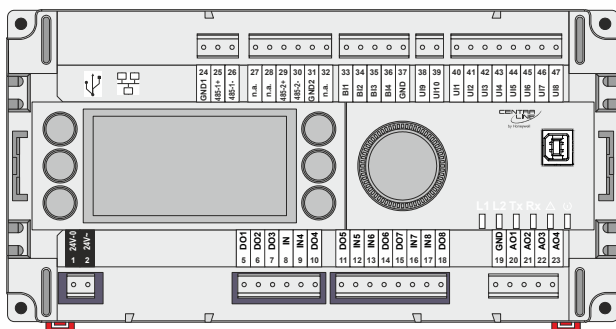

GENERAL

EAGLE is CentraLine's Ethernet-based, freely-programmable Building Automation controller offering a combination of BACnet IP, BACnet MS/TP, and LONWORKS® communication. It demonstrates CentraLine's full commitment to reducing total installed cost and total building lifecycle cost for building investors and building operators.

EAGLE incorporates the two major open standards in today's building industry: BACnet® and LONWORKS®.

As a native BACnet® Building Controller (B-BC), EAGLE integrates into any 3rd-party BACnet® system with low and predictable effort.

Furthermore, EAGLE (in combination with the IF-LON) is a full LONWORKS® controller. This gives the benefit of making use of CentraLine's complete LONWORKS® product portfolio, which is unique in the Building Industry.

EAGLE can host a huge variety of Building Management applications, be it traditional heating, ventilation, and air conditioning (HVAC) applications, energy management functions, including optimum start/stop, night purge, and maximum load demand, supervisory functions for lighting, sun-blind, heat and energy metering and many other applications.

By virtue of its "peer-to-peer" concept, EAGLE is not dependent upon the availability of superordinate centrals or application network controllers.

EAGLE seamlessly integrates into CentraLine's ARENA AX and SymmetrE® front-ends.

FEATURES

- **Reduced the total installed cost:**
Existing standard Ethernet/LAN infrastructure is used for communication between EAGLE controllers, 3rd-party BACnet® controllers, and BACnet® front-ends. Costs are further reduced by the flexible use of onboard I/Os and Panel Bus I/Os.
- **Universal operation:**
Operate EAGLE from any place, from any PC connected to the (EAGLE) network! An integrated web-server allows local and remote operation by standard browsers.
- **Reduced cost for service, operation and maintenance:**
Maintenance or upgrade of Operator Interface Software is superfluous because it resides in EAGLE, itself (single-source principle).
- **Vendor independence:**
Communication is based on the international ISO 16484-5 BACnet® standard and LONWORKS®. Interoperability with 3rd-party BACnet® controllers (peer-to-peer) and front-ends is based on the BACnet® Building Controller (B-BC) profile of EAGLE. Interoperability with room and zone controls, field equipment, and field I/Os is based on LONWORKS®.
- **Trending:**
100 datapoints can be trended.
- **Fast application control:**
Four selectable control loop priorities (multitasking), selectable control loop cycle times, and event-driven switching tables allow for tailored and highly effective applications control.
- **Reliable control performance:**
Embedded LINUX ensures reliable, independent, and secure operation, especially for systems with Internet access.
- **Embedded e-mail/SMS alarming:**
Configurable e-mail alarming options allow alarms to be sent (via network, Internet-DSL connection, or Internet-modem connection) to e-mail accounts and thus also to mobile phones.
- **CentraLine CARE tool:**
Allows re-use of existing applications and application macros, enables highly effective application generation, and supports online debugging and application simulation.
- **Network security:**
Based on its design as an IP device, EAGLE can be easily integrated into any existing network security mechanism.
- **Flexible mounting options:**
Inside cabinet (snapped onto DIN-rail or fastened to inside wall via screw holes provided in housing).

OPERATOR INTERFACE

EAGLE is operated via a standard browser. By default, an integrated web-server provides all operation pages for a full browser-based operation.

Through the consequent use of software standards, any PC platform can be used as an operator interface (client), including laptops, desktops PCs, or touch screen PCs for direct flush mounting into electrical panel doors (IP65).

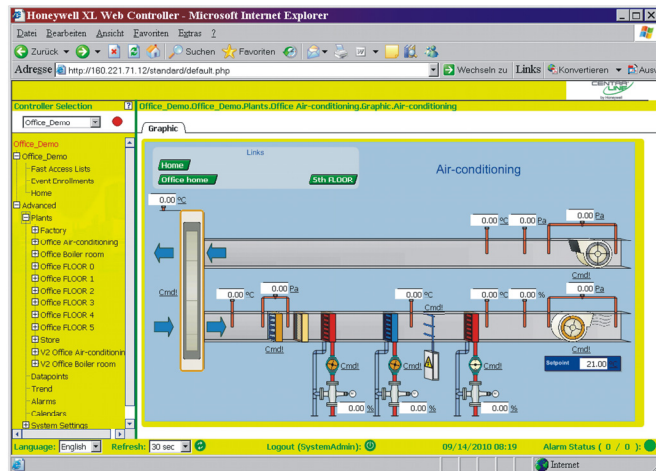


Fig. 1. EAGLE "Homepage" Example

SPECIFICATIONS

Communication Protocols

BACnet/IP - ISO 16484-5 – ENV 13321-1

Communication with other EAGLE controllers, 3rd-party BACnet devices, Honeywell Enterprise Buildings Integrator™ and SymmetRE front-ends, and with 3rd-party BACnet front-ends is based on the international BACnet Protocol.

EAGLE conforms to the BACnet Building Controller (B-BC) profile.

For details on the BACnet Interoperability, see the EAGLE Protocol Implementation Conformance Statement (PICS).

BACnet MSTP – ISO 16484-5

Communication with other BACnet controllers (Honeywell and 3rd-party) is based on the international BACnet Protocol.

LonTalk®

Communication with physical I/O modules, with room and zone controllers, and with CentralLine PANTHER, TIGER, and LION controllers is based on LonTalk.

With the IF-LON, a Free Topology Transceiver (FTT-10A or FT-X1) allows a communication speed of 78 Kbaud.

In typical cases, field devices are controlled via LION I/O modules. Max. cable lengths: 320 m to 2,200 m.

By default, the EAGLE XIF comprises the LonMark® node object, plus application-specific LONWORKS objects.

HTTP

EAGLE provides two operating options:

- Internet browsers having a resolution of 800x600 pixels or higher. Operation has been optimized for I.E. (9.0.x) and Mozilla Firefox® (15.0.x).
- Internet Explorer for WIN CE with resolution of 320x240 pixel, to be used with CE web pages.

For Internet Browser settings, please consult the Software Release Bulletin.

FTP

The firmware and application are downloaded using CARE via the standard FTP (File Transfer Protocol). Via FTP, product or plant-related literature can be downloaded (without special tools) into EAGLE for later use.

SMTP

Simple Mail Transfer Protocol is used for e-mail alarming via network, Internet-DSL connection, and Internet-modem connection.

Hardware Interfaces

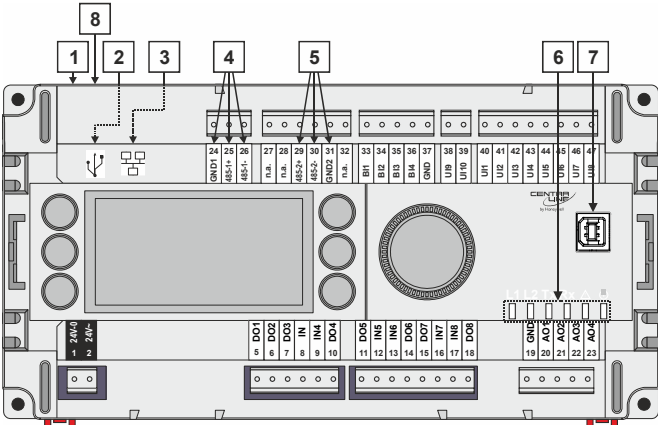


Fig. 2. Bus and port connections, LEDs (top view)

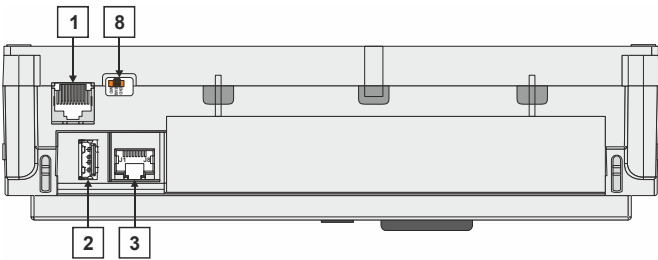


Fig. 3. Bus and port connections (side view)

Legend

- 1 RS232 / RJ45 socket (for factory debugging, only)
- 2 USB 2.0 Host Interface (for connection of, e.g., the IF-LON); max. 500 mA, high speed
- 3 ETHERNET / RJ45 socket (CLEA2000Bxx and CLEA2026Bxx, only); 10/100 Mbit/s; 1 "activity" LED
- 4 RS485-1 (isolated)
- 5 RS485-2 (non-isolated)
- 6 LEDs
- 7 USB 2.0 Device Interface (for connection to CARE / XW-Online)
- 8 Three-position slide switch (for setting bias and termination resistance of RS485-1)

Controller Specifications

Table 1. Controller specifications

Ambient temperature	0 ... 50 °C
Storage temperature	-20 ... +70 °C
Humidity	5 ... 95% r.h. non-condensing
Dimensions	See Fig. 5 and Fig. 6.
Degree of protection	IP20
Fire class	V0
Shock protection	Class II
Pollution degree	2
Installation	Class 3
Rated impulse voltage	2500 Vac
Automatic action	Type 1.C
Software class	Class A
Ball-pressure test temperature	housing parts >75°C terminals >125°C

Electrical Data

Table 2. Electrical data

Power supply	19 ... 29 VAC or 20 ... 30 VDC
Power consumption	typically dc: 5 W; max. 6 W typically ac: 9 VA; max. 11 VA
Current consumption	typically dc: 210 mA; max. 240 mA typically ac: 370 mA; max. 410 mA

EAGLE and 24 Vac field devices can obtain their power from the same transformer

Overvoltage Protection: The binary input is protected against 24 Vac and 40 Vdc overvoltage as well as against short-circuiting.

Mechanical Data

Housing Dimensions (L x B x T): 215.5 x 110 x 61 mm

Housing Material: ABS blend; flame retardant V0

Weight: 0.6 kg (without packaging)

Protection Class: IP 20

Mounting

The EAGLE Controller is suitable for mounting as follows:

- ▶ in cabinets;
- ▶ in fuse boxes conforming with standard DIN43880, and having a slot height of max. 45 mm;
- ▶ in cabinet front doors (using accessory MVC-80-AC2);
- ▶ on walls (using accessory MVC-80-AC1).

Calculated Lifetime of Weakest Components

- MTBF ≥ 13.7 years

CPU

Processor

- ARM 32-bit processor, 450 MHz

Operating System: LINUX

Memory

- 128 MB DDR2-RAM
- 1 GB Flash Memory

Real-Time Clock

- accuracy: ± 2 minutes per year (at, typically, 25 °C)
- buffered typically for 72 h by gold capacitor

Standards, Approvals, etc.

- Device meets EN 60730-1 and EN 60730-2-9.
- Refer to Code of Practice standards IEC 61000-5-1 and -2 for guidance.
- The device complies with ETHERNET Protocol versions IEEE 802.3.
- The device supports BACnet IP and BACnet MS/TP communications as per ANSI / ASHRAE 135-2010.

MMI

The CLEA2014B21, CLEA2026B21, and CLEA2000B21 incorporate a user interface (HMI) featuring the following components:

- one LCD Display (1);
- six operating keys (2);
- one Rotate&Push Button (3); and
- six LEDs (4)

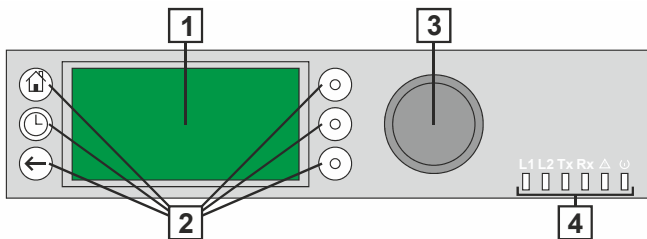


Fig. 4. EAGLE Controller user interface (HMI)

The LCD display is the graphic interface presenting items for application-specific system information, operator entries, and menus of functions. The LCD display can show max. five lines of alphanumeric text with max. 20 characters per line.

The backlight of the LCD is switched on once an operating key or the rotate&push button is pressed. The backlight is switched off if any of the operating keys or the button is not used for 2 minutes.

The six operating keys consist of three fixed-function keys (left) and three soft keys (right).

The Rotate&Push button is used to navigate through menus and lists; to highlight items (menu, list, option, value, command symbol), and to adjust options (ON, OFF, etc.) and values (temperature in °C, etc.).

PROGRAMMING

EAGLE is freely programmable using the graphic CARE Engineering Tool and is thus ideal for all Building Control and Building Management tasks.

PASSWORD PROTECTION

EAGLE allows the definition of up to 6 user levels. Each user level can be assigned different read and write rights. Several users with individual passwords can be defined for each user level.

MODELS

- CLEA2014B21 (with HMI and reduced number of I/Os)
- CLEA2014B01 (with reduced number of I/Os)
- CLEA2026B21 (with HMI and full complement of I/Os)
- CLEA2026B01 (with full complement of I/Os)
- CLEA2000B21 (with HMI, but without onboard I/Os)
- CLEA2000B01 (without onboard I/Os)

Table 3. Overview of models

feature	description	max. cable length	order no.					
			CLEA2014B21	CLEA2014B01	CLEA2026B21	CLEA2026B01	CLEA2000B21	CLEA2000B01
UI	NTC20kΩ / 0...10V / slow BI	400 m	4	4	8	8	-	-
	NTC20kΩ / 0...10V fix pull-up / slow BI	400 m	-	-	2	2	-	-
BI	open = 24 V / closed 2.0 mA / totalizer 15 Hz	400 m	4	4	4	4	-	-
AO	0..11 V (max. 1 mA)	400 m	2	2	4	4	-	-
BO	Relay N.O. contact	400 m	3	3	4	4	-	-
	Relay N.O. contact (high in-rush)	400 m	1	1	1	1	-	-
	Relay N.O. contact with one common	400 m	-	-	3	3	-	-
bus interfaces	RS485-1, isolated, BACnet MS/TP or Panel Bus communication	*1000 m	1	1	1	1	1	1
	RS485-2, not isolated, BACnet MS/TP or Panel Bus communication	40 m	1	1	1	1	1	1
	Ethernet Interface, BACnet IP communication	100 m	-	-	1	1	1	1
	USB 2.0 Device Interface (as Network Interface)	3 m	1	1	1	1	1	1
	USB 2.0 Host Interface (max. 500 mA)	3 m	1	1	1	1	1	1
user interface	HMI with graphic LCD	--	X	-	X	-	X	-
	Fast Access buttons	--	6	-	6	-	6	-
	push and turn button	--	1	-	1	-	1	-
HMI	power LED (green)	--	1	1	1	1	1	1
	status LED (red, controllable by firmware)	--	1	1	1	1	1	1
	applications-specific LED L1 (yellow)	--	1	1	1	1	1	1
	USB-A LED (yellow)	--	1	1	1	1	1	1
	bus status LEDs (for isolated RS485-1 interface)	--	2	2	2	2	2	2

*Depending upon baud rate

DIMENSIONS

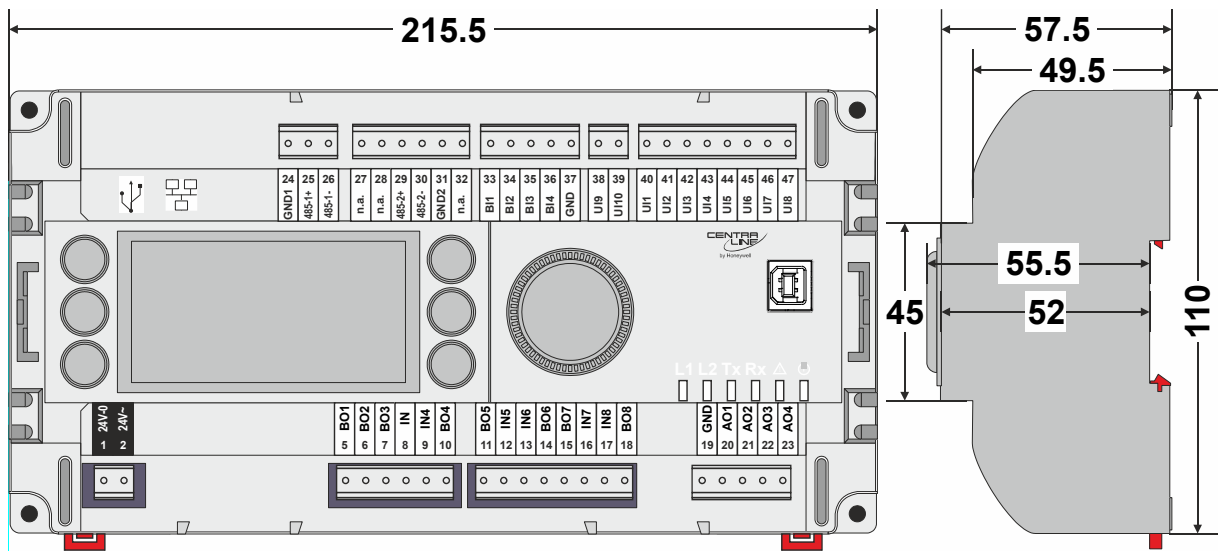


Fig. 5. EAGLE Controller, dimensions (in mm)

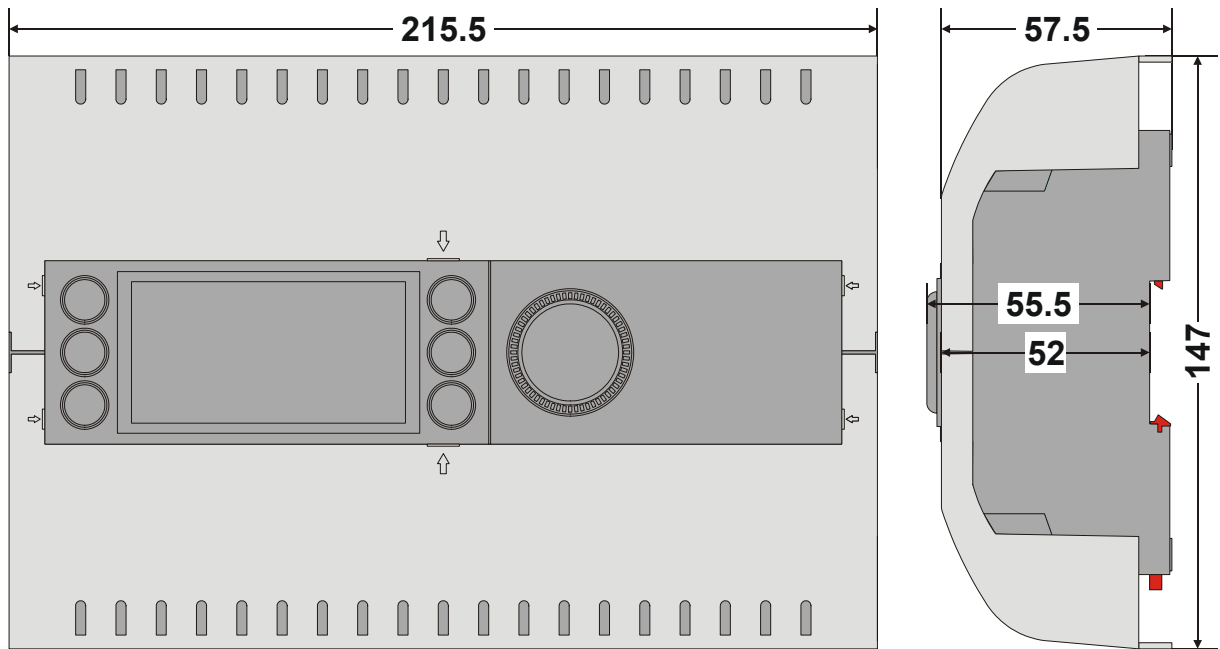


Fig. 6. EAGLE Controller (shown here with two MVC-80-AC1 covers in place), dimensions (in mm)

NOTE: Use of the covers (MVC-80-AC1) will obstruct access to the ETHERNET and USB 2.0 Device Interfaces

Manufactured for and on behalf of the Environmental and Combustion Controls Division of Honeywell Technologies Sàrl, Rolle, Z.A. La Pièce 16, Switzerland by its Authorized Representative:

Centraline
Honeywell GmbH
Böblinger Strasse 17
71101 Schönaich, Germany
phone: +49 7031 637 845
fax: +49 7031 637 740
info@centraline.com
www.centraline.com

Centraline
Honeywell Control Systems Ltd.
Arlington Business Park
UK-Bracknell, Berkshire RG12 1EB
phone: +44 13 44 656 565
fax: +44 13 44 656 563
info-uk@centraline.com
www.centraline.com

Printed in Germany.
Subject to change
without notice.
EN0Z-0970GE51 R1112

